

A REVIEW ON MICROGRID ARCHITECTURE AND CONTROL

Ashutosh Barua

Department of Electronics and Communication, Amity University Madhya Pradesh

ABSTRACT

Microgrid is developing day by day with the rapid increase in the power demand by industries as well as by domestic and commercial sectors, there is an urgent need to meet the growing demand. Microgrid with distributed generation is playing an essential role in fulfilling this increasing demand of power. Microgrid comprises of distributed generators, batteries, connected loads and electronic interfaces. Nowadays distributed power generation which consists of a diesel generator with renewable are widely used. Microgrid with Solar is the most commonly used renewable power source of power generation in distributed generation. This paper reviews the various Issues, architectures, control and energy management aspects of microgrid have been discussed. A review is done of various Control techniques and energy management aspects of microgrid. Pros and cons are also discussed.

Key Words:Microgrid, Solar, Renewable

INTRODUCTION

Microgrid is interconnected system of generators and electrical load for a local area it provides viable solution for villages and remote areas, where the grid connectivity is not proper and cost of electricity per Kwh generated by diesel generator is very high and also the fuel is nonrenewable, therefore there is a requirement to switch from diesel generator to renewable energy sources like solar Photo Voltaic (PV)[1,2].

ISSUES IN MICROGRID

Microgrid become complicated system with the use of renewable systems, resulting in increased issues. Renewable energy sources provides a clean and green energy, which is helpful in reducing carbon emission from the environment and to protect our planet. As there are various advantages of using renewable energy sources but the main disadvantage is that it lags with the synchronous generator inertia [3, 5]. This may lead to serious instability in voltage and frequency in the system which can further result into grid failure if the load demand is not met at the particular time instantly. The above mentioned issues are need to be considered before establishing any microgrid, some issues and challenges in distributed microgrid are as follows:

- As the power supplied to the main grid can be injected as renewable energy sources produces DC power, that need power electronic devices and power converters for connecting main grid with microgrid and renewable sources. These power electronics devices inject various harmonics to the main grid resulting in degradation of power quality. Some active filter connected converters have helped in mitigating the harmonics but at the same time it also increases the cost of the overall system.
- Frequency and voltage variation caused by variation in the demand and supply due to lag in the system inertia.
- Fault protection is one of the issue when renewable sources are connected microgrid as every element need to be protected with internal faults as well as external faults.

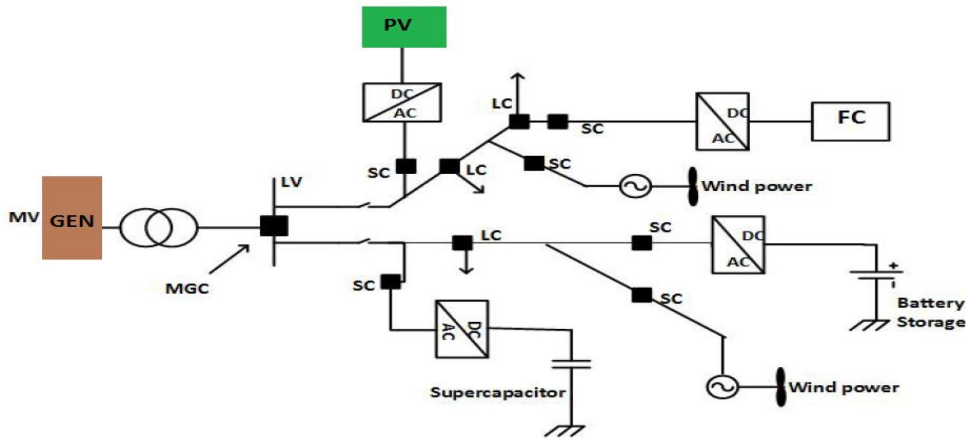


Fig.1. General Microgrid design

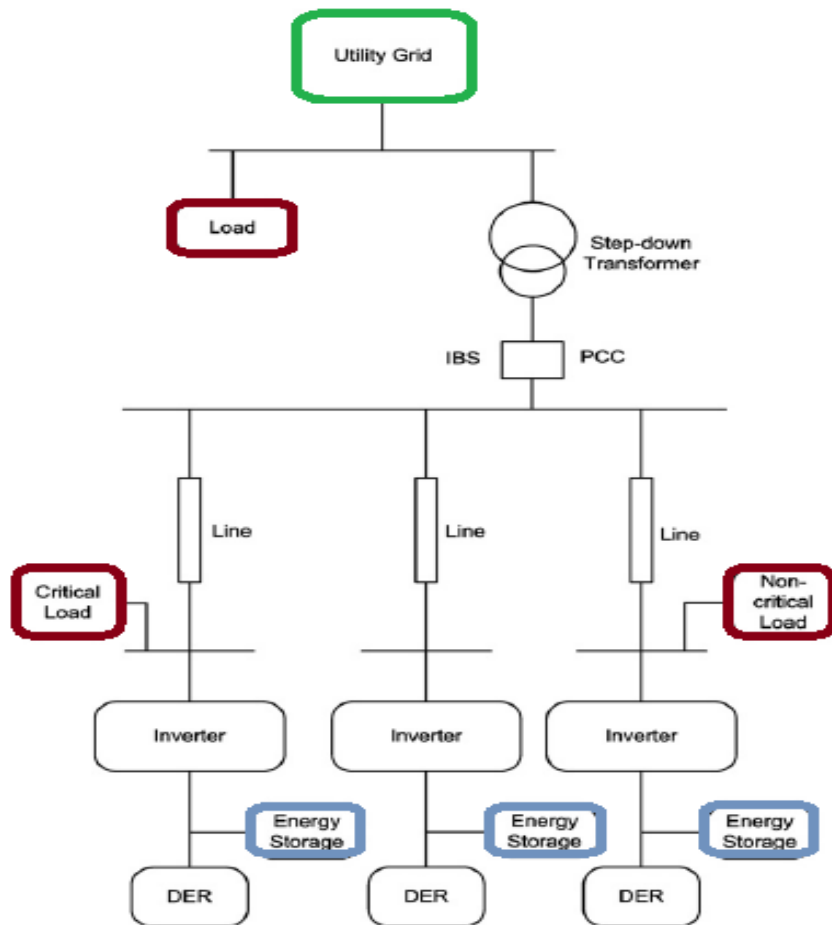


Fig.2. Architecture of microgrid

MICROGRID CONTROL

In a microgrid active and reactive power need to be controlled this can be explained as follows:

DC current control: It is one of the important control in microgrid, In DC current control the P reference generates the current reference which which ultimately results in working of converter it acts as current controlled voltage source.

PQ control: In PQ control mode the reactive power (Q) and active power (P) output from the converter are controlled by controlling the quadrature axis and direct axis current of the converter output.

Voltage source Inverter control: In this type of control the converter operates as Voltage Source Inverter (VSI) imitating the action of a synchronous generator. The droop characteristic is used for finding the Q and P reference.

The microgrid can be operated in Islanded mode or in grid connected mode. In grid connected mode surplus power by the microgrid can be injected to the main public grid, and power can be drawn from the need when required, In Islanded mode of operation, microgrid is disconnected from the main grid, and power generated by the microgrid can only be utilized within the grid and there will be no external exchange of power with the main grid. But in islanded mode stability is the major issue. In the absence of synchronous machines the converters have to emulate the droop characteristics and ensure frequency stability. Then Voltage Sources Inverter control scheme is suited for this. There are two main control strategies under islanded mode of operation [10-12]

1. Single Master Operation (SMO) is where one converter connected to source or storage element will operate in VSI mode. This converter will therefore set a voltage and frequency reference for the grid. The other converters will work in PQ control mode.
2. Multi Master Mode(MMO) in this mode more than one converter will work in VSI mode setting the voltage and frequency reference while others work in the PQ control mode.

Control levels can be classified as four categories (a) Centralized control. (b) Decentralized control. (c) Distributed control. (d) Hierarchical control. Decentralized control is based on local control of microgrid, distributed control is control of both local as well as neighboring communication controls. The hierarchical control structure divides the control into two phases, one at the central level and another at local level and thus whole system operates in more effective way. Centralized control, as shown in Fig. 3(a), collects data from all Microgrids. The advantages of centralized control provides more strong observability and controllability of the entire system. However, suffers with one drawback that it suffers with one point failure resulting in disconnection of power. Therefore centralized system is more suitable in small microgrid as there is limit information gathered and optimization can be done using low communication and system cost.

Decentralized control can be explained using Fig. 3(b) this type of control does not require any information from other controllers and each controller is responsible for its own system and data collection is done separately. Decentralized control does not require any real time data communication. Droop control is one of the example of decentralized control. It can achieve power sharing between Diesel generators without any communication, but its accuracy is restricted by system control and its configuration and depends upon its electrical parameters. The main challenge of a fully distributed control is the coordination among distributed units achieve either control or optimization of the system, which basically require a good communication system for its appropriate function.

A hierarchical control system is explained in Fig.3 (d), most commonly used in microgrid. Functions can be fed at two levels at central level and at local levels, Hierarchical control is therefore becoming a standardized configuration in Microgrids.

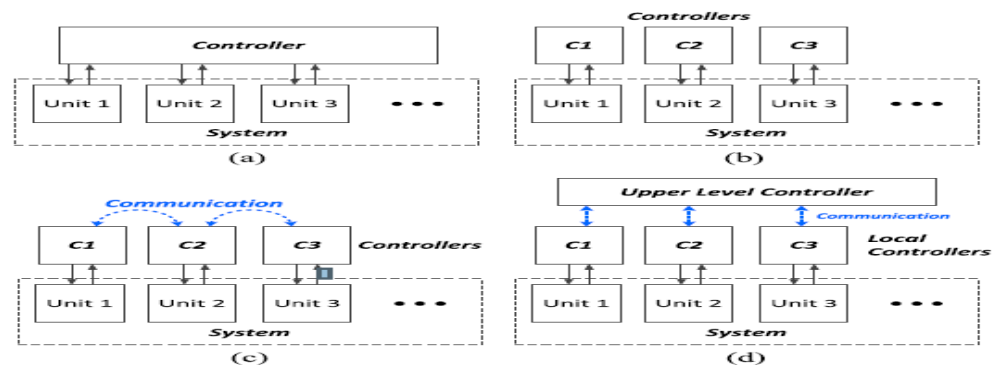


Fig.3. Basic Control Structures a) Centralized. b) Decentralized. c) Distributed. d) Hierarchical

ENERGY MANAGEMENT ASPECTS OF MICROGRID

In the microgrid application scenario, one of the challenging tasks is reducing large energy imbalances due to the uncertainty in power supply from intermittent renewable energy source based distributed generators (DGs) and the dynamic nature of electricity consumption. Fortunately, advances in information and communication technologies (ICT) along with more and more heterogeneous flexible loads, such as plug-in electric vehicles (PEVs), thermostatically controlled loads (TCLs) and distributed energy storage (DES), enable a great opportunity to develop the demand response (DR) and demand side management (DSM) in smart grid applications. These technologies provide a lot of energy management approaches to ensure that the power demand can be rescheduled according to the power supply from utilities or local microgrids through directly or indirectly load control strategy[14-15].

Type	Pros	Cons
Centralized control	<ul style="list-style-type: none"> • Easy to implement • Easy to maintenance in the case of single point failure 	<ul style="list-style-type: none"> • Computational burden • Not easy to expand (so it is not suitable for smart grids) • Single point of failure (highly unstable) • Requires a high level of connectivity
Decentralized control	<ul style="list-style-type: none"> • Local information only • No need for a comprehensive two-way high-speed communication • Without leaders, system still includes Some control island-area • Parallel computation 	Absence of communication links between agents restricts performance Moderate scalability
Distributed control	<ul style="list-style-type: none"> • Easy to expand (high scalability) • Low computational cost (parallel computation) • Avoids single point of failure • Suitable for large-scale systems • Not affected by changes in system Topology. • practical solution for plug-and-play characteristic of smart grid 	<ul style="list-style-type: none"> • Needs synchronization • May be time-consuming for local agents to reach consensus • Convergence rates may be affected by the communication network topology • Needs a two-way communication infrastructure • Cost to upgrade on the existing control and communication infrastructure

Table.1.Energy Management

In the last few years, there have been more and more retailers and utilities investing in DR programs, utilizing changes in end-users’ power demand as one of the methods to increase power demand elasticity. Usually, most demand response actions may be either responses to changes in the electricity prices over time, or incentives from utilities that result in peak shaving or even the relief of congested networks incentive agreement. With the development of networked microgrids, those incentives also include local power supply situations and relevant generation forecast. Generally, there are two demand response mechanisms, namely incentive-based and price-based. Each DR mechanism comprises a number of DR alternatives that can be adopted, which are shown in Table.2.

DR program	Time of Use	Critical Peak Pricing	Real Time Pricing	Direct Load Control	Bidding	Emergency	Interruptible

			(RTP)				
Rule	Non-dispatchable	Both	Non-dispatchable	Dispatchable	Dispatchable	Dispatchable	Dispatchable
Response type	Customer side	Customer side	Customer side	Utility side	Customer side	Utility side	Customer side
Advantages	During off peak hours Low price rate, user can shift load with min.	Customer response for a short time period to get discount offers.	The customer can minimize the cost with respect to price change in a day, month	The power supplying company gives good discount for limited or shifting the load to other sources like renewable energy.	The power supplying company gives good discount for limited or shifting the load to other sources like renewable energy.	Customer can get credit or discount rate for the short response.	Customers respond for a short period to get discount rates.
Disadvantages	One price rate for all customers' consumption levels,	The customer should shift or curtail home resource for certain time.	Customers need to instantaneously respond to minimize bill cost.	Authority is given to the company to shift or curtail load to balance the load.	The customer should shift or curtail home resource for certain time.	The customer should shift or curtail home resource for certain time.	The customer should shift or curtail home resource for certain time.

Table.2.Different demand response mechanism**CONCLUSION**

In this review paper this can be concluded that elements connected to the Low voltage side possess the capability to setup its small grid and can manage it in the better way. Various elements in the microgrid possess potential to coordinate with other element using a hierarchical architecture and suitable communication system with the controllers connected with each of the element. The major challenge in micro-grids is the implementation of a robust control capable of operating in the islanded mode and the grid connected mode. The modern microgrid with renewable interconnections possess high potential to bring renewable, distributed energy storage systems, demand response system, controllable loads and communication infrastructure and many other new technologies into one main stream to meet the demand of power, making the system reliable with good power quality.

REFERENCES

1. W. Su, "The Role of Customers in the U.S. Electricity Market: Past, Present and Future," The Electricity Journal, vol. 27, pp.112–125, aug 2014.
2. W. Su and J. Wang, "Energy Management Systems in Microgrid Operations," The Electricity Journal, vol. 25, pp. 45–60, oct2012.
3. Market Data: Microgrids, Campus/Institutional, Commercial & Industrial, Community, Community Resilience, Military, Utility Distribution, and Remote Microgrid Deployments: Global Capacity and Revenue Forecasts," 2016.

4. H. Pourbabak and A. Kazemi, "A new technique for islanding detection using voltage phase angle of inverter-based DGs," *International Journal of Electrical Power & Energy Systems*, vol. 57, pp. 198–205, may 2014.
5. S. Kar, G. Hug, J. Mohammadi, and J. M. F. Moura, "Distributed State Estimation and Energy Management in Smart Grids: A Consensus+Innovations Approach," *IEEE Journal of Selected Topics in Signal Processing*, vol. 8, pp. 1022–1038, dec 2014.
6. R. Deng, Z. Yang, F. Hou, M.-Y. Chow, and J. Chen, "Distributed Real-Time Demand Response in Multiseller-Multibuyer, 2012
7. W. Saad, Z. Han, H. Poor, and T. Basar, "Game-Theoretic Methods for the Smart Grid: An Overview of Microgrid Systems, 2013.
8. R. Deng, Z. Yang, M.-Y. Chow, and J. Chen, "A Survey on Demand Response in Smart Grids: Mathematical Models Demand-Side Management, and Smart Grid Communications," *IEEE Signal Processing Magazine*, vol. 29, pp. 86–105, sep 2012.
9. E. Perea, J. M. Oyarzabal, R. Rodriguez, "Microredesen el Sector Eléctrico," Issue 44, Mar. 2009.
10. C. Marnay, G. Venkataramanan, "Microgrids in the Evolving Electricity Generation and Delivery Infrastructure," in *Proc. IEEE Power Engineering Society General Meeting*, Montréal, Jun. 2006.
11. C. Schwaegerl, L. Tao, J. P. Lopes, A. Madureira, P. Mancarella, A. Anastasiadis, N. Hatziargyriou, A. Krkoleva, "Advanced Architectures and Control Concepts for More Microgrids," More Microgrids, STREP project funded by the EC under 6FP,SES6-019864, Erlangen, Germany, 2009.
12. S. Suryanarayanan, J. Mitra, "Enabling Technologies for the Customer- Driven Microgrid," in *Proc. 2009 IEEE PES General meeting*, Calgary, 26 – 30 Jul. 2009.
13. S.J. Ahn, S.I. Moon, "Economic Scheduling of Distributed Generators in a Microgrid Considering Various Constraints," in *Proc. 2009 IEEE PES General Meeting*, Calgary, 26 – 30 Jul. 2009.
14. B. Kroposki, "An Integration Facility to Accelerate Deployment of Distributed Energy Resources in Microgrids," in *Proc.2009 IEEE PES General Meeting*, Calgary, 26 – 30 Jul. 2009.
15. D. Georgakis, S. Papathanassiou, N. Hatziargyriou, A.Engler, Ch. Hardt, "Operation of a Prototype Microgrid System Based on Microsources Equipped with Fast-Acting Power Electronics Interfaces," in *Proc. 2004 35th Annual IEEE Power Electronics Specialists Conference*, Aachen, Germany, 2004. pp. 2521- 2526.